


Figure 8.14-1b. Water Balance: Maximum Daily

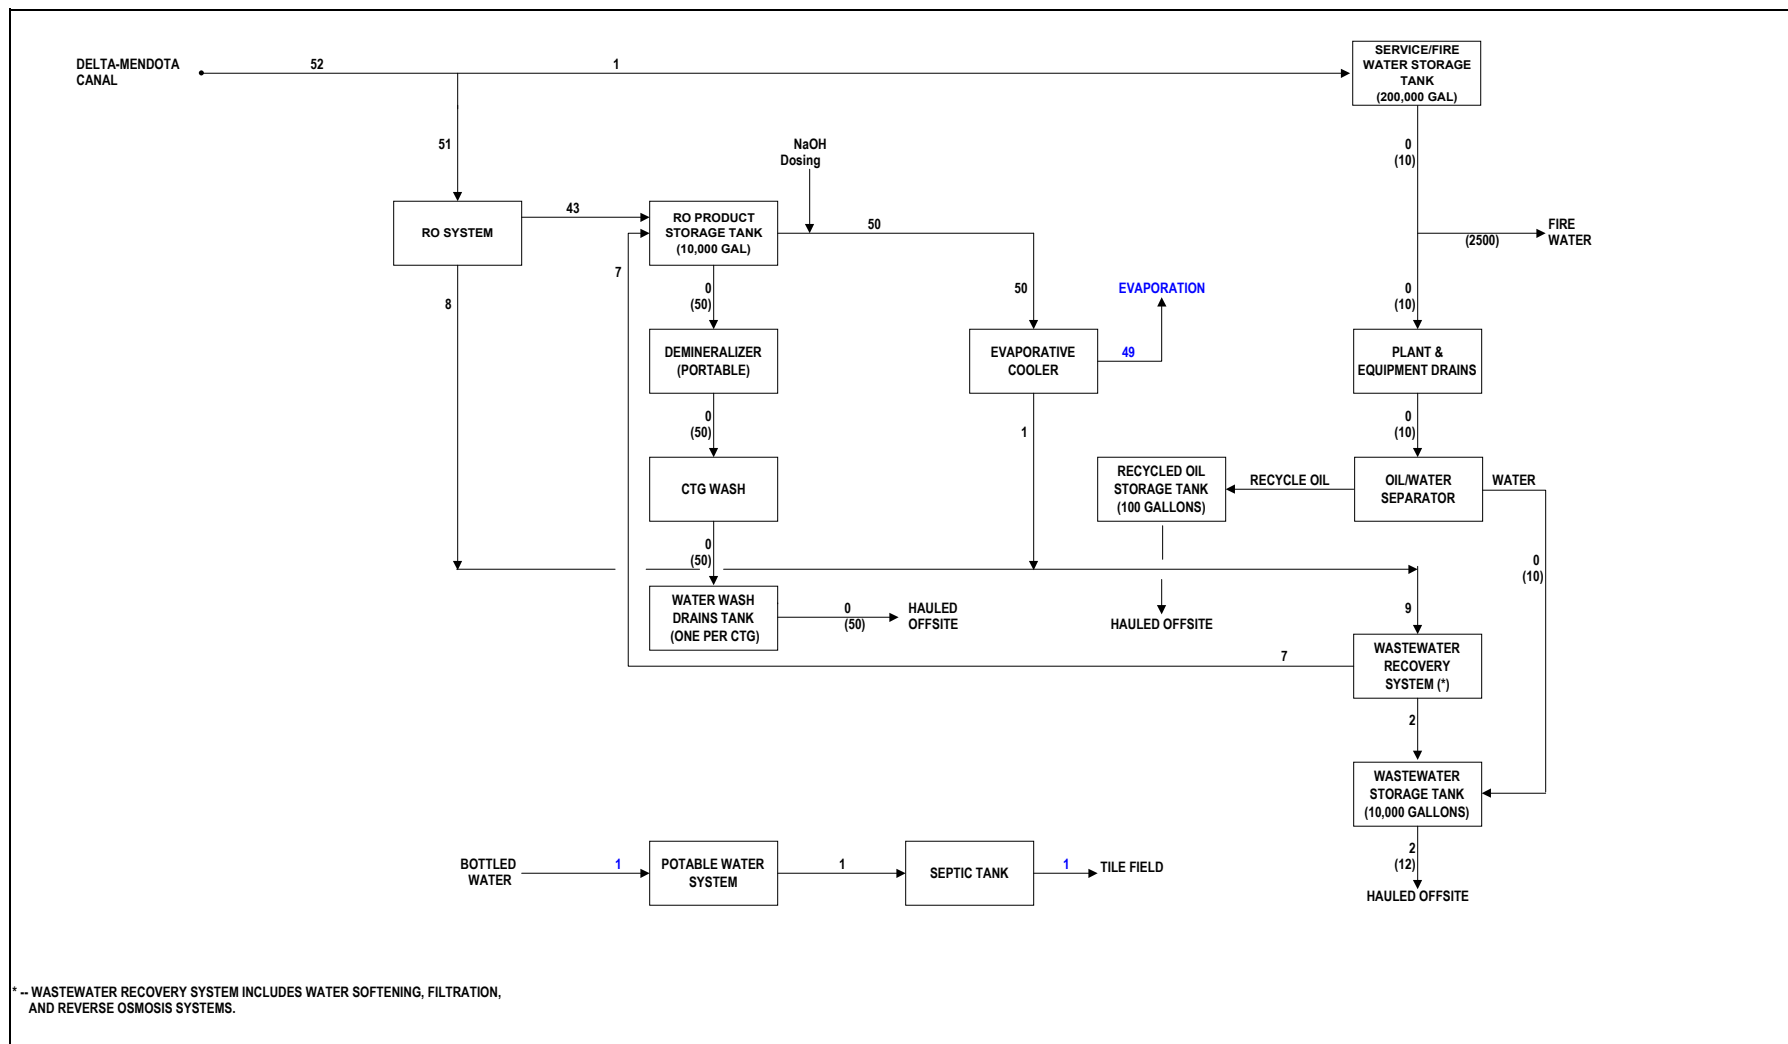

NOTE: 1. FLOWS ARE IN GALLONS PER MINUTE (gpm). 2. PEAK INSTANTANEOUS FLOWS ARE SHOWN IN PARENTHESES. 3. FLOWS ARE PEAK DAILY AVERAGE.	COMBUSTION TURBINE FUEL	NATURAL GAS	TURBINE TYPE	GE 7EA	GWf ENERGY LLC TRACY PEAKER PROJECT PRELIMINARY WATER MASS BALANCE MAXIMUM	Project 069389.0	Drawing WMB-1	Rev E
	LOAD FACTOR	100%	HEAT BALANCE CASE	4				
	AVE. DRY BULB TEMP (F)	98	COMB. TURBINE EVAP. COOLING	ON				
	RELATIVE HUMIDITY	24%	COMB. TURBINE STEAM AUG.	OFF				
	TURBINE CONFIGURATION	2 SC UNITS	DUCT FIRING	OFF				